


## WS Lead Reduction Carbon Block Filter

- ❁ Certified by IAPMO according to NSF/ANSI 42 and 53 for lead reduction, chlorine, taste and odor reduction, as well as material safety
- ❁ Long lifespan for reduced PM frequency (1,500 gallons)
- ❁ Can be used as stand-alone filter or combined with pre and post filters for multi-stage configuration
- ❁ Easy installation
- ❁ Compatible with all Wellsys equipment



# WS Lead Reduction Carbon Block Filter

## Multi-Stage Filtration Process

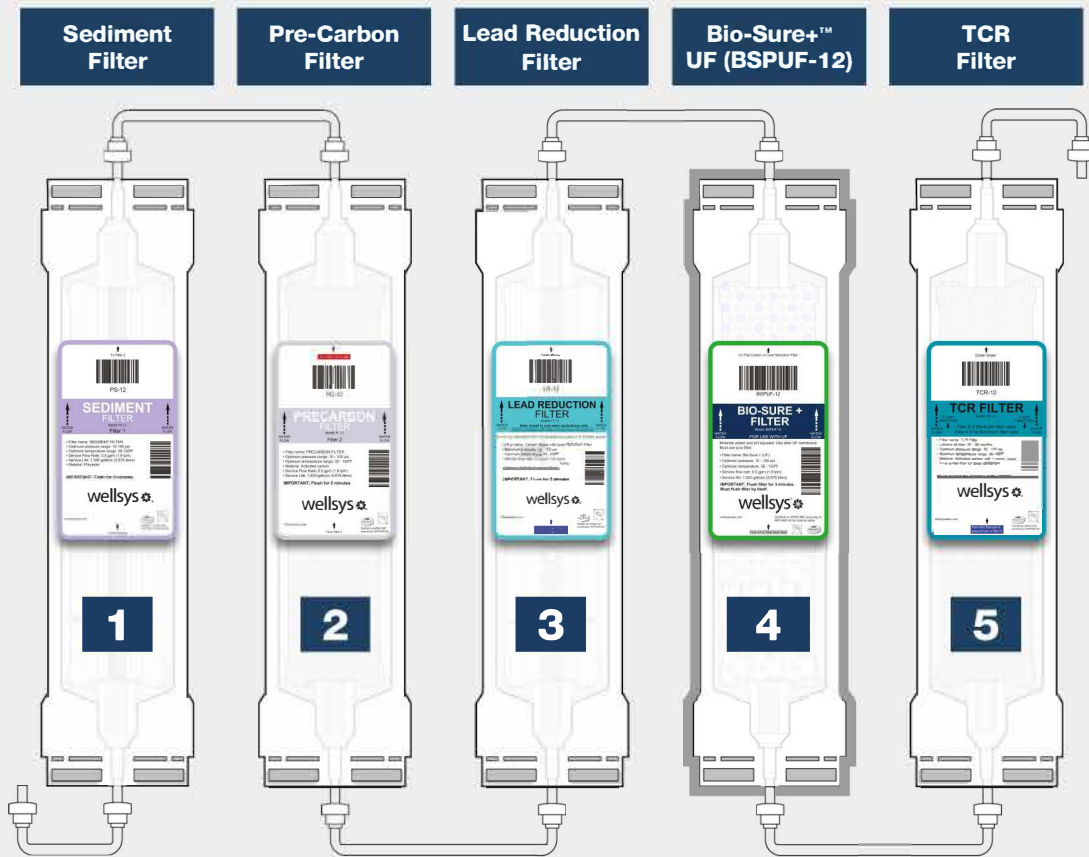

Description	Service life	Service flow rate	Optimum pressure	Dimensions
<b>Sediment Filter</b>	1,500 Gallons (5,678 L)	0.50 GPM (1.9 LPM)	10 - 100 PSIG (0.7 - 6.9 bar), non-shock	12.5" L x 2.5" D
<b>Pre-Carbon Filter</b>	1,500 Gallons (5,678 L)	0.50 GPM (1.9 LPM)	10 - 100 PSIG (0.7 - 6.9 bar), non-shock	12.5" L x 2.5" D
<b>Lead Reduction Filter</b>	1,500 Gallons (5,678 L)	0.50 GPM (1.9 LPM)	10 - 100 PSIG (0.7 - 6.9 bar), non-shock	12.5" L x 2.5" D
<b>Bio-Sure Plus Filter</b>	1,500 Gallons (5,678 L)	0.50 GPM (1.9 LPM)	10 - 100 PSIG (0.7 - 6.9 bar), non-shock	12.5" L x 2.5" D
<b>TCR Filter</b>	1,500 Gallons (5,678 L)	0.60 GPM (1.9 LPM)	10 - 100 PSIG (0.7 - 6.9 bar), non-shock	12.5" L x 2.5" D

**wellsys**®

[www.wellsyswater.com](http://www.wellsyswater.com)

630 Allendale Road, Suite 200  
King of Prussia, PA 19406  
855.558.9796

© 2020 Wellsys. All rights reserved.



Certified by IAPMO R&T according to NSF/ANSI 42 for material safety.  
Lead reduction filter certified by IAPMO according to NSF/ANSI 53 for lead reduction.